22-COMM-B BACnet MS/TP Adapter Firmware v1.002

This release note describes major revision 1, minor revision 2 of firmware for 22-COMM-B BACnet MS/TP adapters.

Introduction

The following information is included in this document:

For information about:	See page:
Enhancements	1
Corrected Anomalies	1
Determining Firmware Revision	2
Firmware Flashing	4
Restrictions	6
Compatible Revisions	6
Rockwell Automation Support	7
Product Satisfaction Return	7

Enhancements

There are no enhancements provided in this revision of firmware.

Corrected Anomalies

This section describes the anomaly corrected in this revision of firmware:

- Fixed the handling of “Who Has” request messages so that requests containing an object name longer than 64 bytes do not cause the adapter to temporarily fall out of the MS/TP token ring.

Determining Firmware Revision

This section describes procedures to determine the firmware revision of your 22-COMM-B BACnet MS/TP adapter.

Using the External LCD HIM (22-HIM-**)

Step	Key(s)	Example Screens
1. Power up the drive. The **Parameters** menu for the drive will be displayed.		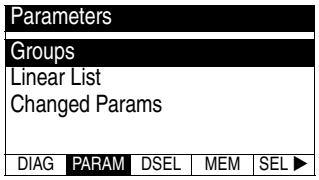
2. Press Sel key until the Device Select menu is displayed, and then press Enter.	Sel and ↵	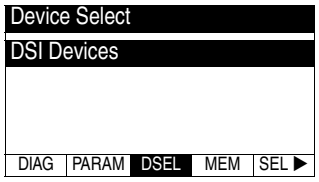
3. Press Down Arrow to scroll to the **22-COMM-B** adapter, and then press Enter.	▼ and ↵	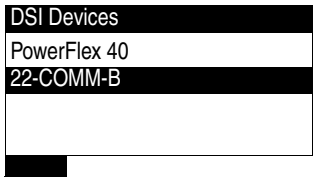
4. Press Sel key until the Diagnostics menu is displayed. Press Down Arrow to scroll to **Device Version**, and then press Enter.	Sel ▼ and ↵	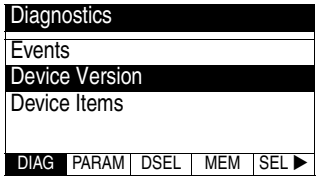
5. The present firmware version of the converter is shown on the Firmware line.		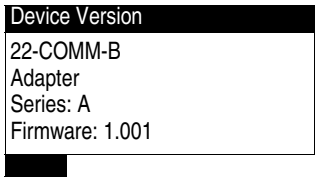

Using DriveExplorer Lite/Full

1. Launch DriveExplorer and go online (via 22-SCM-232 or 1203-USB converter) with the drive that is connected to the adapter.
2. In the DriveExplorer treeview, click on 22-COMM-B BACnet adapter as shown in Figure 1.
3. Click the information icon to display the adapter's properties screen.
4. The "Revision:" field shows the present revision (for example, 1.001) of the adapter firmware.

TIP: When clicking on the 22-COMM-B adapter using version 5.01 or higher DriveExplorer Lite/Full, the adapter firmware revision is also shown in the right pane of the DriveExplorer window.

Figure 1 Information Icon in DriveExplorer Window

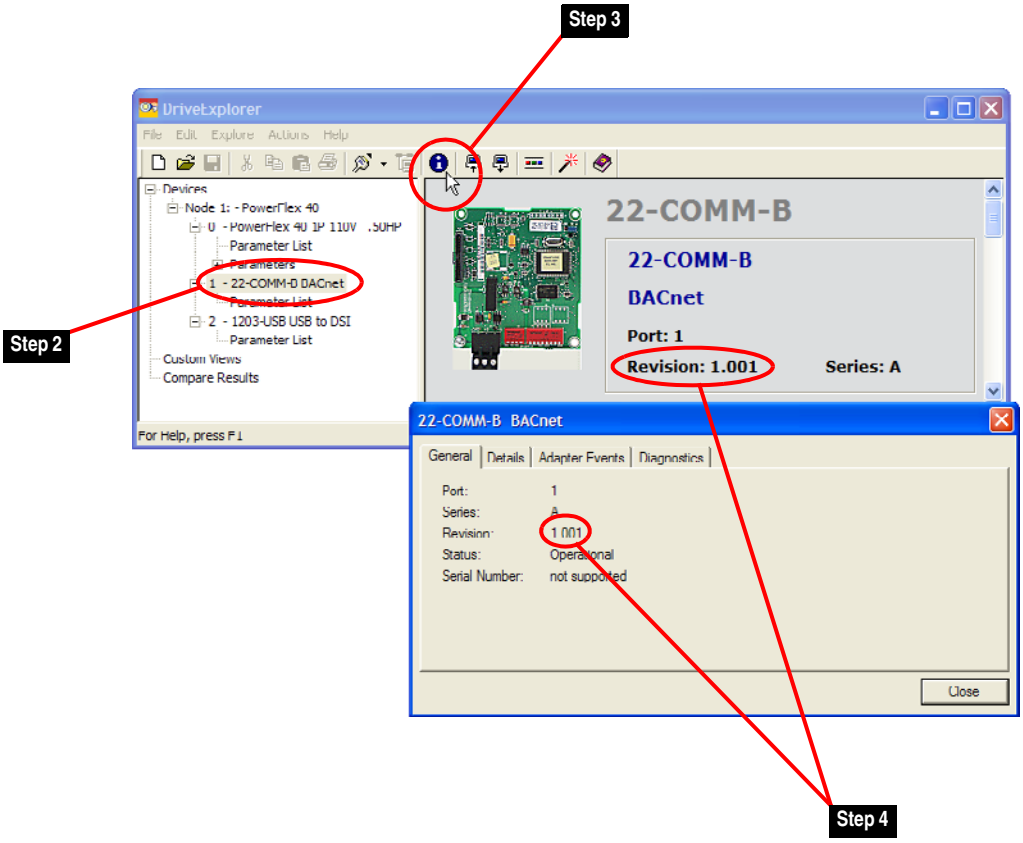

Using DriveExecutive

1. Launch DriveExecutive and go online with the drive that is connected to the adapter.
2. In the DriveExecutive treeview, click on 22-COMM-B as shown in Figure 2.
3. Click the information icon to display the adapter's Properties screen.
4. The "Revision:" field shows the present revision (for example, 1.001) of the adapter firmware.

Figure 2 Information Icon in DriveExecutive Window

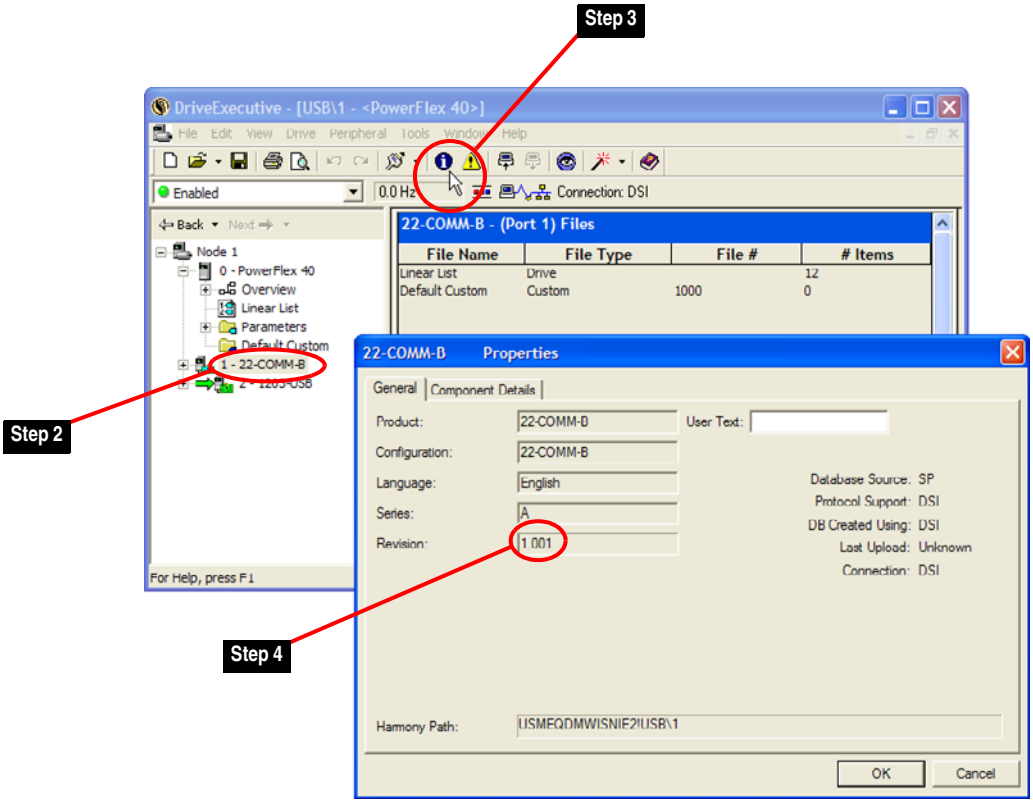

Firmware Flashing

This section describes procedures to flash upgrade your adapter firmware. Flash kits for drives, communications adapters, and peripherals are provided on the Allen-Bradley Web Updates site located at http://www.ab.com/support/abdrives/webupdate.

ATTENTION: Risk of permanent equipment damage exists. Once a flash update has been started, do not remove power from the drive until after the download has completed and the MOD status indicator on the adapter becomes FLASHING GREEN. If power is removed before this occurs, the adapter may be permanently damaged. An adapter that has been damaged in this way cannot be repaired.

Installing the Flash Kit

1. Install the flash kit utility from the Allen-Bradley Web Updates site for the 22-COMM-B adapter. (This also automatically installs the latest version of the ControlFLASH utility on your computer.)
2. You are now ready to use DriveExplorer, DriveExecutive or ControlFLASH to update the adapter. Follow the instructions in the appropriate section below.

Using DriveExplorer Lite/Full

1. With the Flash Kit installed (see Installing the Flash Kit), launch DriveExplorer and go online (via 22-SCM-232 or 1203-USB converter) with the drive that is connected to the adapter.
2. In the DriveExplorer treeview, click on 22-COMM-B BACnet adapter. Then click the information icon as shown in Figure 1 to display the adapter's properties screen.
3. On the 22-COMM-B properties screen, click the Details tab.

   Important: This update may cause the adapter parameters to revert to their default values. You may want to save your configuration using DriveExplorer or the HIM CopyCat feature before upgrading.

4. To start the flash update, click the **Flash Update…** button. Follow the screen prompts until the flash update procedure completes and displays the new firmware revision (v1.002).

Using DriveExecutive

1. With the Flash Kit installed (see Installing the Flash Kit), launch DriveExecutive and go online with the drive that is connected to the adapter.
2. In the DriveExecutive treeview, click on 22-COMM-B. Then click the information icon as shown in Figure 2 to display the adapter's Properties screen.
3. On the 22-COMM-B Properties screen, click the Component Details tab.

   Important: This update may cause the adapter parameters to revert to their default values. You may want to save your configuration using DriveExecutive or the HIM CopyCat feature before upgrading.

4. To start the flash update, click the **Flash Update** button. Follow the screen prompts until the flash update procedure completes and displays the new firmware revision (v1.002).

Using ControlFLASH

1. With the Flash Kit installed (see Installing the Flash Kit on page 5), launch ControlFLASH by selecting **Start > (All) Programs > Flash Programming Tools > ControlFLASH**.
2. Choose the 22-COMM-B v1.002 update from the list of available updates.

   Important: This update may cause the adapter parameters to revert to their default values. You may want to save your configuration using the HIM CopyCat feature, DriveExplorer or DriveExecutive before upgrading.
3. Follow the screen prompts until the flash procedure completes and displays the new firmware revision (v1.002).

Restrictions

No restrictions apply to this revision of firmware.

Compatible Revisions

To use this revision of firmware, update your system tools as follows:

Update this:	To this version or later:
DriveExplorer Lite/Full	4.01
DriveExecutive	3.01
PowerFlex 4-Class Drive	all versions compatible
External LCD HIM (22-HIM-**)	all versions compatible
RSLinx Classic	2.43

Rockwell Automation Support

Rockwell Automation provides technical information on the web to assist you in using our products. At http://support.rockwellautomation.com, you can find technical manuals, a knowledge base of Frequently Asked Questions (FAQs), technical and application notes, sample code and links to software service packs, and a MySupport feature that you can customize to make the best use of these tools.

Rockwell Automation also provides complimentary phone support for drives, communication adapters, and peripherals. If you experience a problem with the adapter, please review the information in its User Manual. For further help in getting your converter operational, contact a Customer Support representative:

United States	(1) 262.512.8176 Monday – Friday, 7am – 6pm CST
Outside United States	Please contact your local Rockwell Automation representative for any technical support issues.

For an additional level of technical phone support for installation, configuration and troubleshooting, we offer TechConnect Support programs. For more information, contact your local distributor or Rockwell Automation representative, or visit http://support.rockwellautomation.com.

Product Satisfaction Return

Rockwell Automation tests all products to ensure that they are fully operational when shipped from the manufacturing facility. However, if your product is not functioning and needs to be returned:

United States	Contact your distributor. You must provide a Customer Support case number (see phone number above to obtain one) to your distributor to complete the return process.
Outside United States	Please contact your local Rockwell Automation representative for return procedure.

U.S. Allen-Bradley Drives Technical Support - Tel: (1) 262.512.8176, Fax: (1) 262.512.2222, Email: support@drives.ra.rockwell.com, Online: www.ab.com/support/abdrives

www.rockwellautomation.com

Power, Control and Information Solutions Headquarters

Americas: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444
Europe/Middle East/Africa: Rockwell Automation, Vorstlaan/Boulevard du Souverain 36, 1170 Brussels, Belgium, Tel: (32) 2 663 0600, Fax: (32) 2 663 0640
Asia Pacific: Rockwell Automation, Level 14, Core F, Cyberport 3, 100 Cyberport Road, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846

Publication 22COMB-RN001A-EN-P – February, 2008

Copyright © 2008 Rockwell Automation, Inc. All rights reserved. Printed in USA.